


1-1/2" DIA. X-STRONG SCHEDULE 40 GALVANIZED OR POWDER COATED STEEL PIPE - CONSTRUCT PLUMB - SEE PLAN FOR LOCATION & EXACT LAYOUT - SEE PLAN FOR LENGTH OF GUARD RAIL SYSTEM WHICH SHALL BE A MIN. OF 30" WIDER (ON EACH END) THAN THE ROOFTOP OBJECT THAT FALL PROTECTION IS BEING PROVIDED FOR - NOTE THAT IF GALVANIZED PIPE IS USED, SEAL ANY HOLES OR OTHER PENETRATIONS USED FOR THE GALVANIZING PROCESS



PLAN VIEW OF STEEL PLATE

STEEL PLATE DESIGN / WELDING OF PIPE TO PLATE AND ATTACHMENT OF PLATE TO DECK MUST BE DESIGNED BY STRUCTURAL ENGINEER

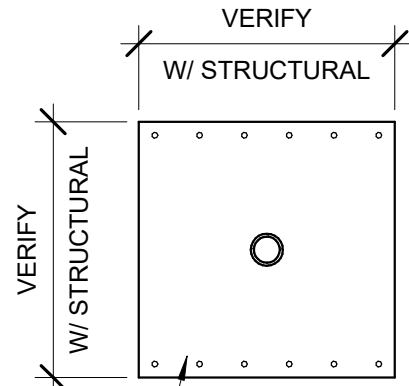